

Symaro™

## Duct Temperature Sensor Modbus RTU

QAM2151.040/MO, QAM3153.040/MO



### Duct temperature sensor with Modbus communication

- Modbus RTU (RS-485)
- On-event addressing via push button together with Climatix™ controllers
- DIP switches setting together with other controllers

## Use

The duct temperature sensor is used in ventilation and air conditioning plants as:

- Supply or exhaust air temperature sensors
- Limit sensors, for example, for minimum limitation of the supply air temperature
- Reference sensors, for example, for compensation of the room temperature as a function of the outside temperature
- Dew point temperature sensors
- Measuring sensors, for example, for measured value indication or for connection to a building automation and control system

## Technical design

Cable entry is made via the M16 cable entry gland (QAM2151.040/MO: IP54, QAM3153.040/MO: IP65) supplied with the sensor which can be screwed into the housing. Probe and housing are rigidly connected.

A rubber seal is installed between base and cover in order to satisfy the requirements of IP65 degree of protection. (QAM3153.040/MO)

The sensor is designed for screwed or flanged mounting.

It can be fitted as follows:

- With the mounting flange supplied with the sensor (recommended), which is to be fitted to the sensor and then secured according to the required immersion length
- Without the mounting flange (using the maximum immersion length). For that propose, the housing has 4 holes for fitting the sensor directly to the air duct

## Type summary

Product number	SSN NO.	Probe length	Measuring range	Measuring accuracy	Operating voltage	Output signal	IP
QAM2151.040/MO	S55720-S466	0.4 m	-50...50 °C	-25...25 °C: ±0.75 K -50...50 °C: ±0.9 K	AC 24 V ±20 %/ DC 13.5...35 V	Modbus RTU	IP54
QAM3153.040/MO	S55720-S630	0.4 m	-50...50 °C	23 °C: ±0.2 K -25...25 °C: ±0.75 K -50...50 °C: ±0.9 K	AC 24 V ±20 %/ DC 13.5...35 V	Modbus RTU	IP65

## Ordering and delivery

When ordering, specify name and product number, for example: Duct temperature sensor QAM2151.040/MO.

The sensor is supplied complete with mounting flange AQM63.0 and cable entry gland M16.

## Notes

### Engineering

Powering the sensor requires a transformer for safety extra low-voltage (SELV) with separate windings for 100 % duty. When sizing and protecting the transformer, comply with all local safety regulations.

When sizing the transformer, determine the power consumption of the room sensor.

For correct wiring, see the datasheets of the devices with which the sensor is used.

Observe permissible line lengths.

### Cable routing and cable selection

Note that when routing cables, the longer the cables run side by side and the smaller the distance between them, the greater the electrical interference. Shielded cables must be used in environments with EMC problems.


Twisted pair cables are required for the secondary supply lines and the signal lines.

Mounting and installation

- Mounting location
- For supply air temperature control: Downstream from the fan, if the fan is located after the last air handling unit. Otherwise, after the last air handling unit with a minimum distance of 0.5 m
  - For exhaust air temperature control: Always upstream of the exhaust air fan
  - As a limit sensor for the supply air temperature: As close as possible to the air outlet into the room
  - For dew point control: Immediately after the spray trap of the air washer
- Manually bend the probe so that it lies diagonally across the duct or in equally spaced windings across the entire duct cross-section. The probe must not touch the duct wall.

QAM3153.040/MO


NOTICE	
!	Make sure the cover housing is installed on the corresponding base (same printed number locates at ① ②) during mounting. Otherwise, accuracy may be affected.

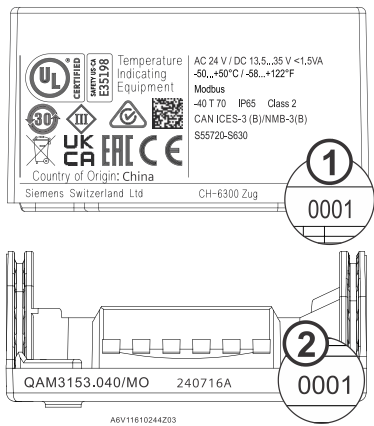


Mounting instructions

Mounting instructions are enclosed in the package.

Mounting positions

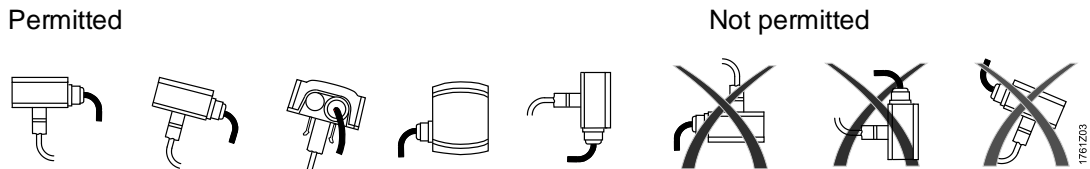

Mounting examples

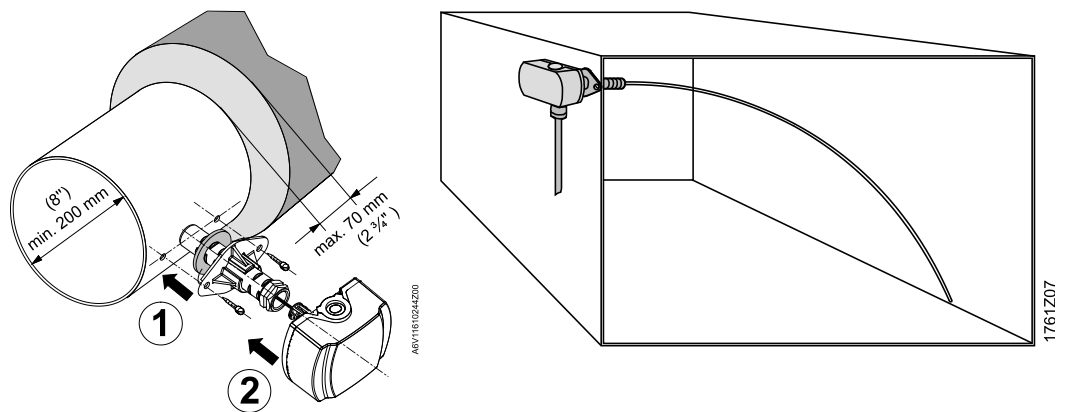

## Disposal



This symbol or any other national label indicate that the product, its packaging, and, where applicable, any batteries may not be disposed of as domestic waste. Delete all personal data and dispose of the item(s) at separate collection and recycling facilities in accordance with local and national legislation.

For additional details, refer to [Siemens information on disposal](#).

## Technical data

Function	
Communication	Modbus RTU (RS-485)
Supported baud rate	9600; 19200; 38400; 57600; 76800; 115200
Transmission format	1-8-E-1; 1-8-O-1; 1-8-N-1; 1-8-N-2
Bus termination	120 ohm, jumper selection

For detailed information about specific functions, see Basic documentation (A6V11610643 \*).

Power supply	
Operating voltage	Safety extra-low voltage (SELV) AC 24 V $\pm 20\%$ or DC 13.5...35 V or AC/DC 24 V class 2 (US)
Frequency	50/60 Hz at AC 24 V
External supply line protection (EU)	Fuse slow max. 10 A or Circuit breaker max. 13 A Characteristic B, C, D according to EN 60898 or Power source with current limitation of max. 10 A
Power consumption	$\leq 1.5$ VA

Functional data	
Measuring range	-50...50 °C
Probe Probe length Minimum bending radius	0.4 mm 10 mm
Sensing element	Pt 1000
Time constant	30 s at 2 m/s
Dead time	< 1 s
Measuring accuracy in the range of 23 °C (QAM3153.040/MO) -25...25 °C -50...50 °C	$\pm 0.2$ K $\pm 0.75$ K $\pm 0.9$ K


Ambient conditions and protection classification	
Protection degree of housing QAM2151.040/MO QAM3153.040/MO	IP54 according to EN 60529 IP65 according to EN 60529
Protection class	III according to EN 60730-1
<b>Environmental conditions</b> Transport <ul style="list-style-type: none"> <li>• Climatic conditions <ul style="list-style-type: none"> <li>– Temperature</li> <li>– Humidity</li> </ul> </li> <li>• Mechanical conditions</li> </ul> Operation <ul style="list-style-type: none"> <li>• Climatic conditions <ul style="list-style-type: none"> <li>– Temperature (housing)</li> <li>– Humidity (housing)</li> </ul> </li> </ul>	IEC 60721-3-2 <ul style="list-style-type: none"> <li>• Class 2K3 <ul style="list-style-type: none"> <li>– -25...70 °C</li> <li>– &lt; 95 % r.h.</li> </ul> </li> <li>• Class 2M2</li> </ul> IEC 60721-3-3 <ul style="list-style-type: none"> <li>• Class 3K5 <ul style="list-style-type: none"> <li>– -40...70 °C</li> <li>– 5...95 % r.h.</li> </ul> </li> </ul>

Standards, directives and approvals	
Product standard	EN 60730-1, EN 60730-2-9, EN 61000-6-2, EN 61000-6-3 Automatic electrical controls for household and similar use
EU conformity (CE)	A5W00037903A *)
RCM conformity	A5W00037912A *)
UL	UL 873, <a href="http://ul.com/database">http://ul.com/database</a>
UKCA	A5W00188742A *)
Environmental compatibility	The product environmental declaration (A5W90011832 *) contains data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal).

General	
Line lengths for measuring signals Perm. cable lengths Copper cable 0.6 mm dia. Copper cable 1 mm <sup>2</sup> Copper cable 1.5 mm <sup>2</sup>	50 m 150 m 300 m
Electrical connections terminals for	1 × 2.5 mm <sup>2</sup> or 2 × 1.5 mm <sup>2</sup>
Cable entry gland (enclosed)	M 16 × 1.5
<b>Materials and colors</b>	
Probe	Copper, polyolefine
Base	Polycarbonate, RAL 7001 (silver-grey)
Cover	Polycarbonate, RAL 7035 (light-grey)
Mounting flange	PA 66 (black)
Cable entry gland	PA, RAL 7035 (light-grey)
Packaging	Corrugated cardboard
Weight including package QAM2151.040/MO QAM3153.040/MO	Approx. 213.8 g Approx. 240 g

\*) The documents can be downloaded from <http://siemens.com/bt/download>.


Connection terminals

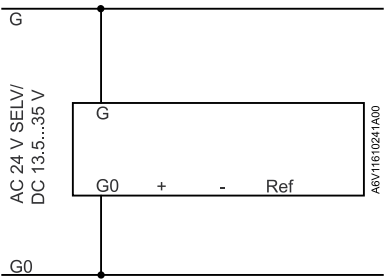


- G            Operating voltage AC 24 V  $\pm$ 20 % or DC 13.5...35 V
- G0          Ground
- +            RS485 Modbus A
- RS485 Modbus B
- Ref          GND\_ISO


## Dimensions

QAM2151.040/MO

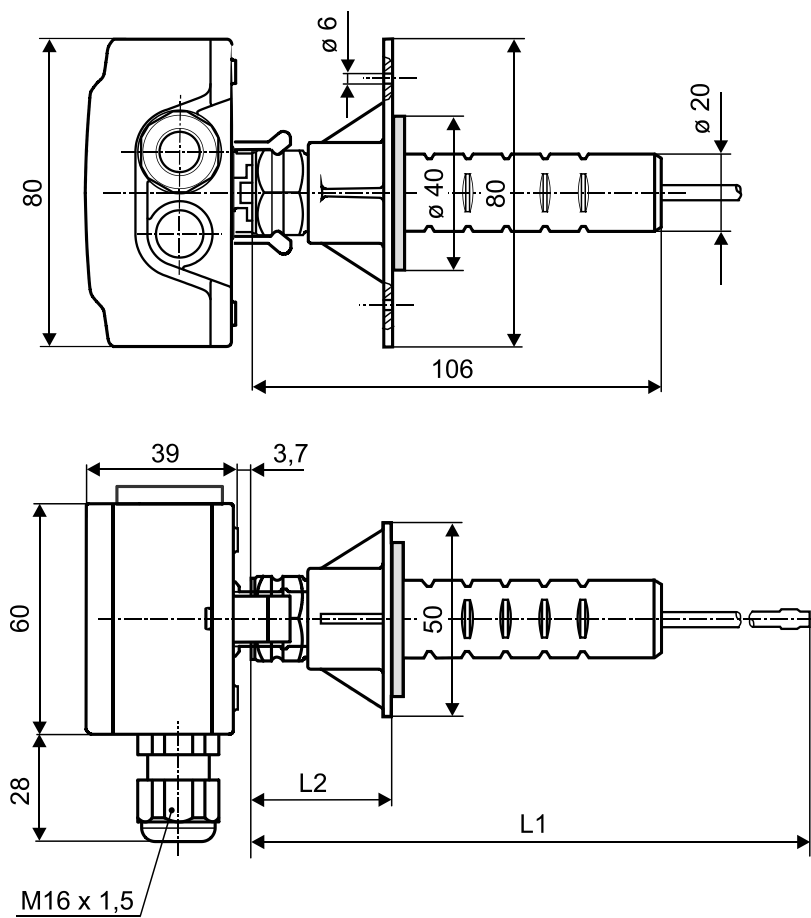


L1	L2	
	max.	min.
400	97	37

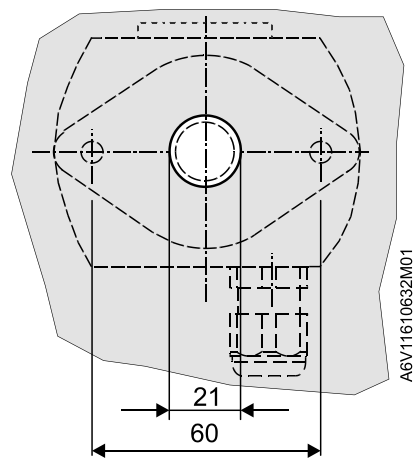

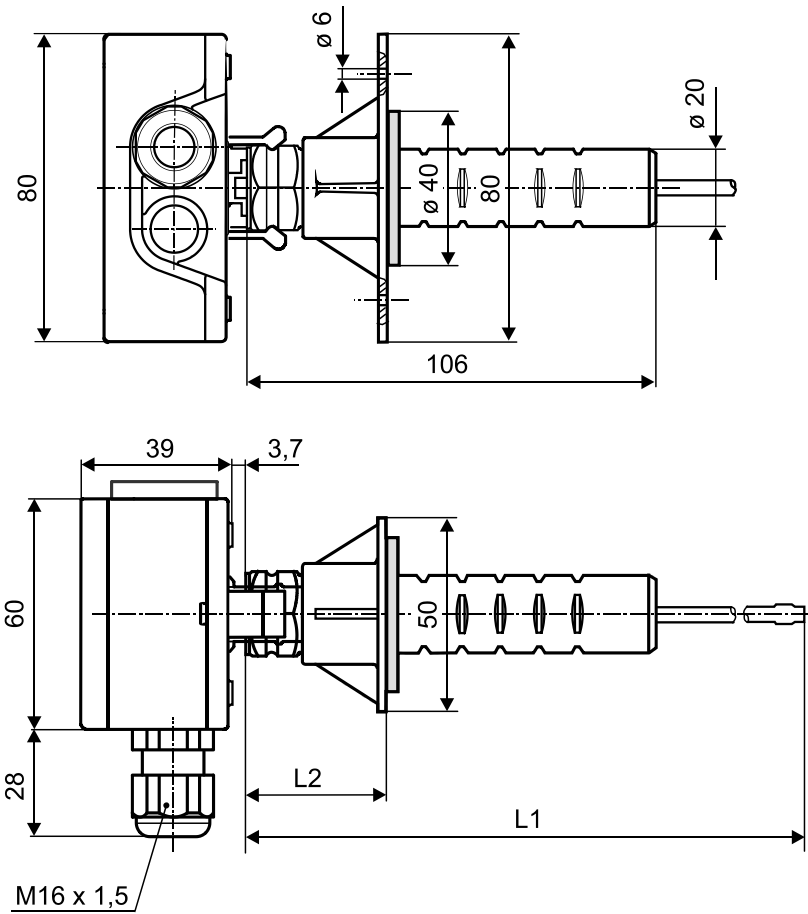

L1	L2	
	max.	min.
400	97	37

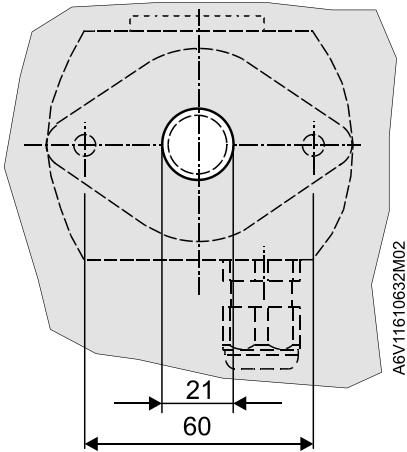

Dimensions in mm





Issued by  
Siemens Switzerland Ltd  
Smart Infrastructure  
Global Headquarters  
Theilerstrasse 1a  
CH-6300 Zug  
+41 58 724 2424  
[www.siemens.com/buildingtechnologies](http://www.siemens.com/buildingtechnologies)

© Siemens 2019  
Technical specifications and availability subject to change without notice.

---

Document ID    A6V11610632\_en--\_c  
Edition        2024-01-19